

Ultra-stable, high precision (ppm class) fluxgate technology DM Series current transducer for non-intrusive, isolated DC and AC current measurement up to 1800A



**Features**

- Ø45mm aperture enabling large isolated cables and the possibility to measure leakage current at high precision.
- 1 ppm linearity
- 10 ppm offset
- Current output
- Fluxgate, closed loop compensated technology with crystal driven excitation frequency for increased stability
- Industry standard DSUB 9 pin connection
- Full aluminum body for superior EMI shielding and extended operating temperature range

**Applications:**

- Power measurement and power analysis
- Stable power supplies
- MPS for particles accelerators
- Gradient amplifiers for MRI devices
- Precision drives
- Batteries testing and evaluation systems
- Current calibration purposes


Specification highlights	Symbol	Unit	Min	Typ	Max
Nominal primary AC current	$I_{PN AC}$	Arms			1200
Nominal primary DC current	$I_{PN DC}$	A	-1500		1500
Measuring range	$I_{PM}$	A	-1800		1800
Primary / secondary ratio	$n1 : n2$		1:1500		1:1500
Linearity error	$\epsilon_L$	ppm	-1		1
Offset current (including earth field)	$I_{OE}$	ppm	-10		10
DC-10Hz Overall accuracy @25°C (= $\epsilon_L + I_{OE}$ )	acc $\epsilon$	ppm	-11		11
AC Maximum gain error 10Hz to 3kHz	$\epsilon_G$	%			±0.01
Operating temperature range	$T_a$	°C	-40		85
Power supply voltages	$U_c$	V	±14.25		±15.75

All ppm (or %) values refer to nominal current


## Electrical specifications at Ta=23°C, supply voltage = ± 15V unless otherwise stated

Parameter	Symbol	Unit	Min	Typ.	Max	Comment
Nominal primary AC current	$I_{PN AC}$	A <sub>rms</sub>			1200	Refer to fig. 1 & 2 for derating
Nominal primary DC current	$I_{PN DC}$	A	-1500		1500	Refer to fig. 1 for derating
Measuring range	$I_{PM}$	A	-1800		1800	Refer to fig. 1 & 2 for derating
Overload capacity	$\hat{I}_{OL}$	kA			5	Non-measured, 100ms
Nominal secondary current	$I_{SN}$	mA	-1000		1000	At nominal primary DC current
Primary / secondary ratio			1:1500		1:1500	
Measuring resistance	$R_M$	$\Omega$	0		3	Refer to fig. 1 for details
Linearity error	$\epsilon_L$	ppm	-1		1	ppm refers to nominal current
		$\mu A$	-1		1	$\mu A$ refers to secondary current
Offset current	$I_{OE}$	ppm	-10		10	ppm refers to nominal current
		$\mu A$	-10		10	$\mu A$ refers to secondary current
DC-10Hz Overall accuracy @25°C (= $\epsilon_L + I_{OE}$ )	acc $\epsilon$	ppm	-11		11	ppm refers to nominal DC current
Offset temperature coefficient	$T_{C_{IOE}}$	ppm/K	-0.1		0.1	ppm refers to nominal current
		$\mu A/K$	-0.1		0.1	$\mu A$ refers to secondary current
Bandwidth	$f(-3dB)$	kHz	400			Small signal, graphs figure 3
Amplitude error	$\epsilon_G$	10Hz - 3kHz			0.01%	% refers to nominal current
		3kHz - 50kHz			1.00%	
		50kHz - 300kHz			20.0%	
Phase shift	$\theta$	10Hz - 3kHz			0.01°	
		3kHz - 50kHz			0.5°	
		50kHz - 300kHz			10°	
Response time to a step current $I_{PN}$	$t_r @ 90\%$	$\mu s$		1		$di/dt = 100A/\mu s$
Noise	noise	ppm rms	0 - 100Hz		0.05	Measured on secondary current
			0 - 1kHz		0.06	
			0 - 10kHz		0.70	
			0 - 100kHz		2.0	
Fluxgate excitation frequency	$f_{Exc}$	kHz		31.25		
Induced rms voltage on primary conductor		$\mu V$ rms			5	
Power supply voltages	$U_c$	V	±14.25		±15.75	
Positive current consumption	$I_{ps}$	mA	135	140	145	Add $I_s$ (if $I_s$ is positive)
Negative current consumption	$I_{ns}$	mA	120	130	135	Add $I_s$ (if $I_s$ is negative)
Operating temperature range	$T_a$	°C	-40		85	
<b>Stability</b>						
Offset stability over time		ppm/month	-0.1		0.1	ppm refers to nominal current
		$\mu A$ /month	-0.1		0.1	$\mu A$ refers to secondary current
Offset change with vertical external magnetic field		$\mu A$ /mT		0.2	0.8	(perpendicular to bus bar) $\mu A$ refers to secondary current
Offset change with horizontal external magnetic field		$\mu A$ /mT		0.8	2	(parallel to bus bar) $\mu A$ refers to secondary current
Offset change with power supply voltage changes		$\mu A$ /V		0.004	0.04	$\mu A$ refers to secondary current
Offset change with absolute power supply voltages tracking		$\mu A$ /V		0.012	0.04	$\mu A$ refers to secondary current


Maximum external resistance value (Fig. 1)

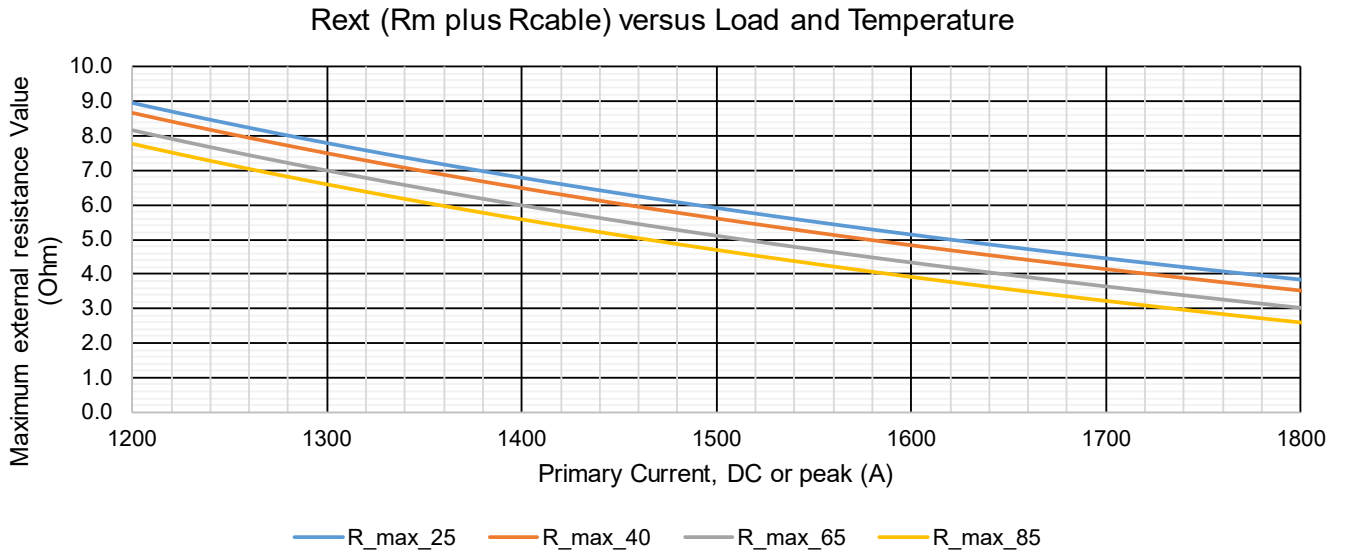

Frequency and ambient temperature derating (Fig. 2)

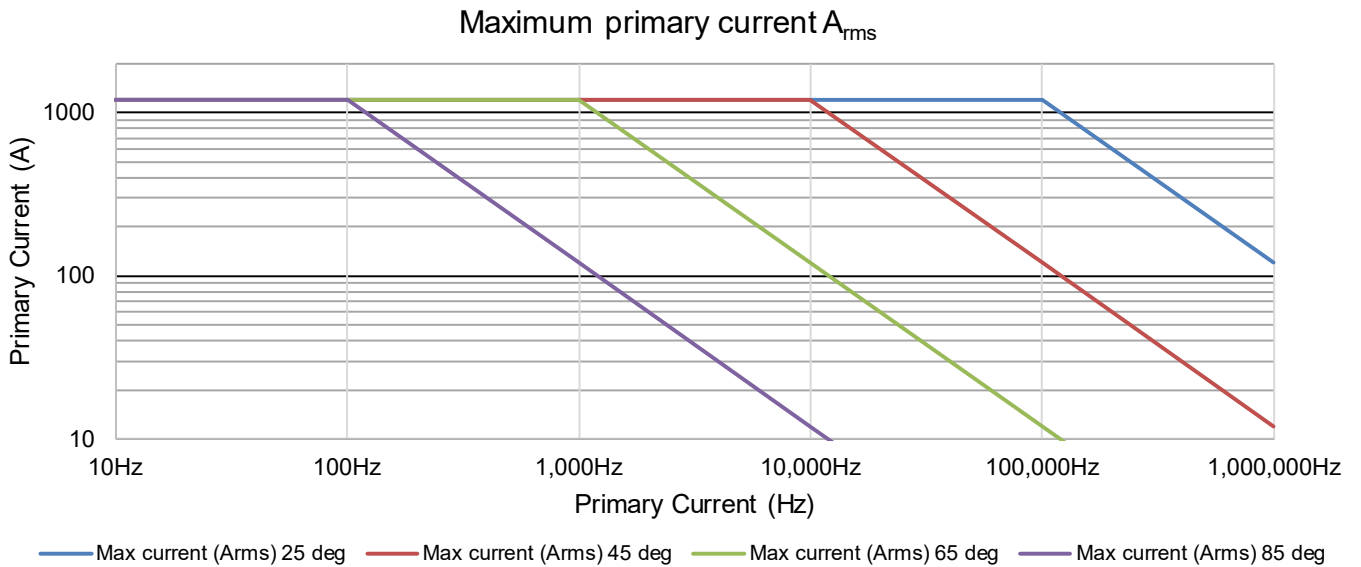

Frequency characteristics (Fig. 3)

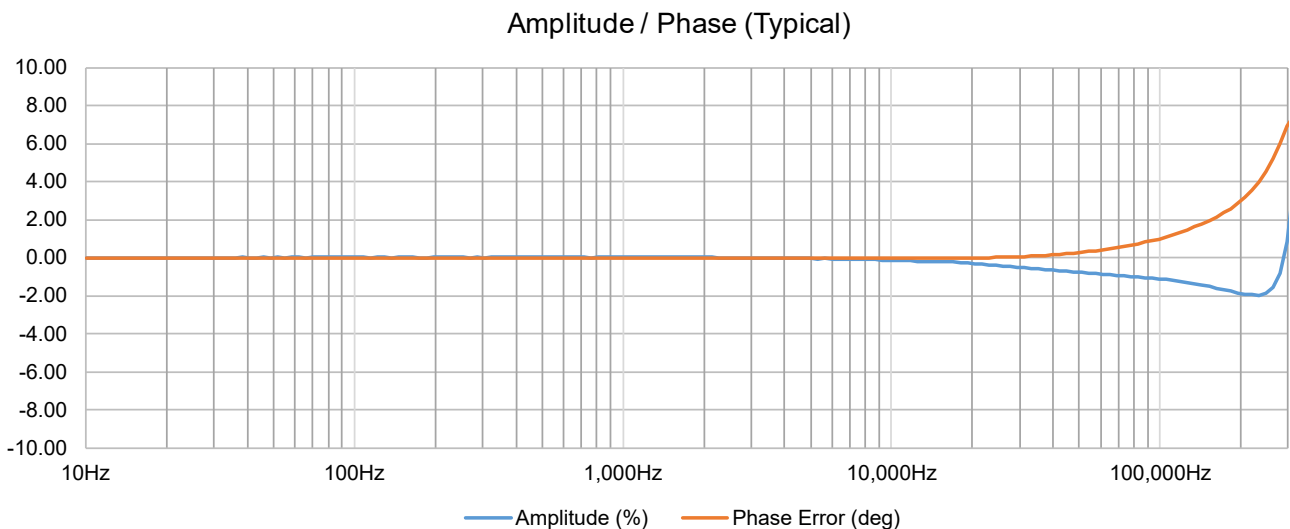

**Isolation specifications**

Parameter	Unit	Value
Clearance	mm	12
Creepage distance	mm	12
Comparative tracking index (CTI)		> 600
Rms voltage for AC isolation test, 50/60 Hz, 1 min - Between primary and (secondary and shield) - Between secondary and shield	kV	5.7 0.2
Impulse withstand voltage (1.2/50µs)	kV	10.4
Continous working voltage with uninsulated wire • Non mains • CAT II (DC and rms) • CAT III (DC and rms) Insulated wire • Non mains • CAT II (DC and rms) • CAT III (DC and rms)	V	1000 600 300  2000 1000 1000
Transient voltage with uninsulated wire • Non mains • CAT II • CAT III Insulated wire • Non mains • CAT II • CAT III	V	4500 6000 6000  6000 6000 8000

**Caution:** Do not connect the transducer to signals or use for measurements within Measurement Category IV, or for measurements on MAINS circuits or on circuits derived from Overvoltage Category IV which may have transient overvoltages above what the product can withstand. The product must not be connected to circuits that have a maximum voltage above the continuous working voltage, relative to earth or to other channels, or this could damage and defeat the insulation. The product can only withstand transients up to the transient overvoltage rating without breakdown or damage to the insulation. An analysis of the working voltages, loop impedances, temporary overvoltages, and transient overvoltages in the system must be conducted prior to making measurements.



**Caution:** When using insulated wires all wiring must be insulated for the highest voltage used.



**Absolute maximum ratings**

Parameter	Unit	Max	Comment
Primary	kA	4.5	Maximum 100ms
Power supply	V	±16.5	

## Environmental, safety and mechanical specifications

Parameter	Unit	Min	Typ	Max	Comment
Altitude	m			2000	
Usage					Designed for indoor use
Transient voltages					Up to overvoltage category III
Poution Degree				2	
Ambient operating temperature range	°C	-40		85	
Storage temperature range	°C	-40		85	
Relative humidity	%	20		80	Non-condensing
Mass	kg		1.8		
Connections	DSUB9 male and BNC connector				
Standards	IEC61010-2-30, IEC61326-1 EMC and EC61010-1:2010 3rd Edition				
External devices	External devices connected to current transducers must comply with the standards IEC61010-1, IEC60950 or IEC62368-1 and be energy-limited circuitry				
Cleaning	The transducer should only be cleaned with a damp cloth. No detergent or chemicals should be used.				
Temperature	<p>When multiple primary turns are used or high primary currents are applied the temperature around the transducer will increase, please monitor to ensure that the maximum ratings are not exceeded.</p> <p>It is recommended to have minimum 1mm<sup>2</sup> per ampere in the primary busbar.</p>				

## Advanced Sensor Protection Circuits “ASPC”

Developed to protect the current transducer from typical fault conditions:


- Unit is un-powered and secondary circuit is open or closed
- Unit is powered and secondary circuit is open or interrupted

Both DC and AC primary current up to 100% of nominal value can be applied to the current transducers in the above situations without damage to the electronics.

Please notice that the transducer core can be magnetized in all above cases, leading to a small change in output offset current (less than 10ppm)

## Accessories

- 4-channel power supplies unit for connection up to 4xDM1200 : [DSSIU-4](#)
- 6-channel power supplies unit for connection up to 6xDM1200 : [DSSIU-6](#)
- Transducer cables in 5 lengths (2m - 5m - 10m - 15m - 20m): [DSUB2 - DSUB5 - DSUB10 - DSUB15 - DSUB20](#)
- Transducer cable 3m for connection to end-user’s power supply: [Transducer cable for lab PS](#)  
(with access to current output via  $\phi 4$  banana jacks)

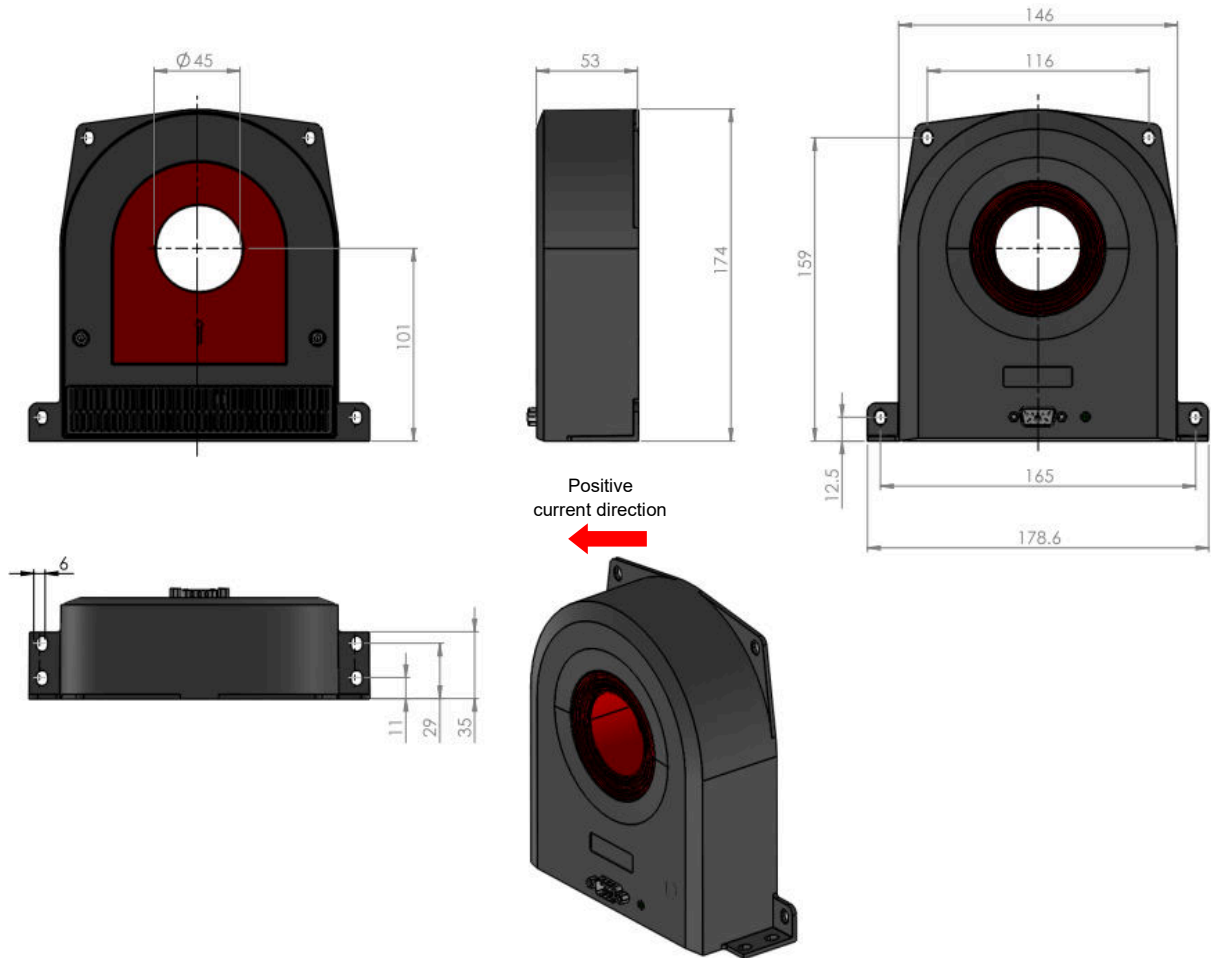


Dimension in mm (general tolerance 0.3mm unless otherwise stated)

Standard DSUB-9 current output



When sensor is operating in normal condition the status pins are shorted.

- Status pin properties.
- Forward direction pin 8 to pin 3
  - Maximum forward current 10mA
  - Maximum forward voltage 60V
  - Maximum reverse voltage 5V

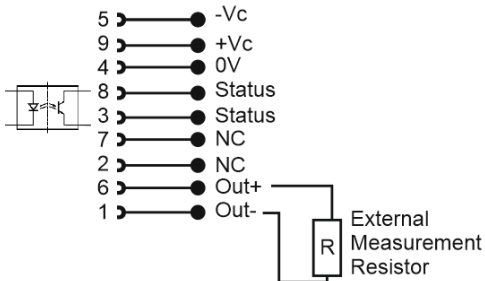

**Positive current direction**

Is identified by an arrow on the transducer body

**Mounting instructions**

- Horizontal or vertical mounting
- 4 holes Ø6 x 11  
4 x M5 steel screws / 6N.m

## **Declaration of Conformity**

Danisense A/S  
Malervej 10  
DK-2630 Taastrup  
Denmark

Declares that under our sole responsibility the products listed in Appendix A are in conformity with the provisions of the following EC Directives, including all amendments, and with national legislation implementing these

directives:

Directive 2014/30/EU

Directive 2014/35/EU

And that the following harmonized standards have been applied

EN 61010-1 (Third Edition):2010, EN 61010-1:2010

EN 61010-2-030:2010

EN 61326-1:2013

All DANISENSE products are manufactured in accordance with RoHS directive 2011/65/EU. Annex II of the RoHS directive was amended by directive 2015/863 in force since 2015, expanding the list of 6 restricted substances (Lead, Hexavalent Chromium, PBB, PBDE and Cadmium)

Danisense follows the provision in EN 63000:2018

Appendix A describes the products covered by this Declaration of Conformity.



Place

Taastrup, Denmark

Henrik Elbæk

Date

2022-03-15